



INSTITUT PRO TESTOVÁNÍ A CERTIFIKACI, a. s.

třída Tomáše Bati 299, Louky, 763 02 Zlín, Czech Republic

Testing Laboratory

Testing laboratory * Calibration laboratory * Product certification body * Quality management systems certification body
Inspection body * Authorized body * Notified body

Number of pages: 3

Page : 1

ref. No. 412502675

TEST REPORT

ref. No. 412502675

Client: Zavod Logicroof LLC
VAT: RU6230054971

Address: Vostocny Promuzel 21, 390047 Ryazan Russia

Sample: Planter Eco
Logicbase V-SL

Sample received on: 21st of September 2016

Report elaborated by: Ing. Radim Mikač

Place and date of issue: Zlín, 9th of January



Ing. Jiří Samsonek, Ph.D.
Head of Testing Laboratory

*Note: The results given in this Test Report apply only to the sample tested by our laboratory!
Without a written consent by Institut pro testování a certifikaci, a.s. Zlín, the Test Report may not be reproduced unless as a whole!*



Description and identification of samples:

Table No. I - Sample description and identification

ITC's identification number	Sample identification by client	Description of submitted sample
2675/S/1	Planter Eco foil	black drainage foil
2675/S/2	Logicbase V-SL	gray and yellow plastic foil

Sampling method:

The samples were supplied to the laboratory by the client. The laboratory is not responsible for mistakes caused by the wrong way of sampling.

Specification:

Determination of root puncture resistance

Testing method used:

Determination of resistance to root according to CEN/TS 14416

Conditions test:

3 test specimens of diameter 200mm, test duration: 8 weeks (for winter time), tested from 10th of November 2016 to 5th of January 2017

Test result:

The test results are given in the following table:

Table No. II – Planter Eco foil – ref.No. 2675/S/1

Characteristics measured	Unit	Test results
Roots puncture	-	The roots have not penetrated the samples

Table No. II – Logicbase V-SL – ref.No. 2675/S/2

Characteristics measured	Unit	Test results
Roots puncture	-	The roots have not penetrated the samples

*Note: The results given in this Test Report apply only to the sample tested by our laboratory!
Without a written consent by Institut pro testování a certifikaci, a.s. Zlín, the Test Report may not be reproduced unless as a whole!*

Photo No. 1 - Control of the vitality of the plants – The roots penetrated bitumen layer



Photo No. 2 and 3 – The roots have not penetrated the Planter Eco foil



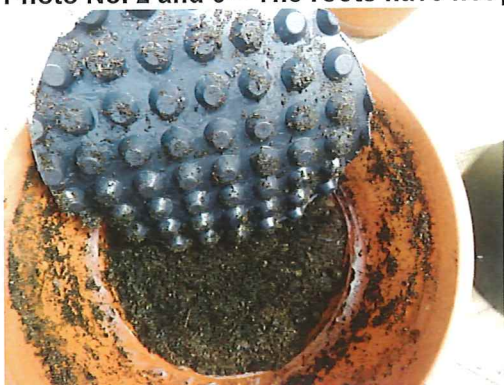


Photo No. 4 and 5 – The roots have not penetrated the Logicbase V-SL

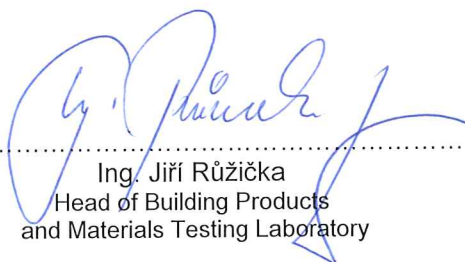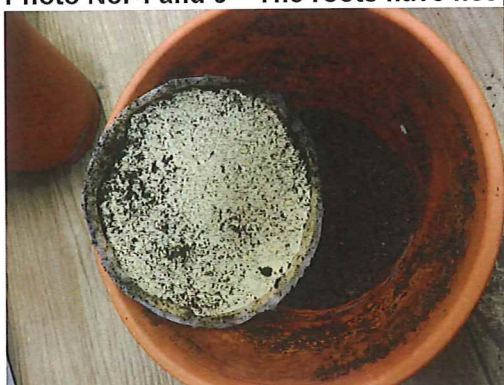

Ing. Jiří Růžička
Head of Building Products
and Materials Testing Laboratory

*Note: The results given in this Test Report apply only to the sample tested by our laboratory!
Without a written consent by Institut pro testování a certifikaci, a.s. Zlín, the Test Report may not be reproduced unless as a whole!*